


FLOWABLE FILL SHALL BE A MAX  
OF 4' FROM TOP OF BEDDING TO  
BOTTOM OF PAVEMENT

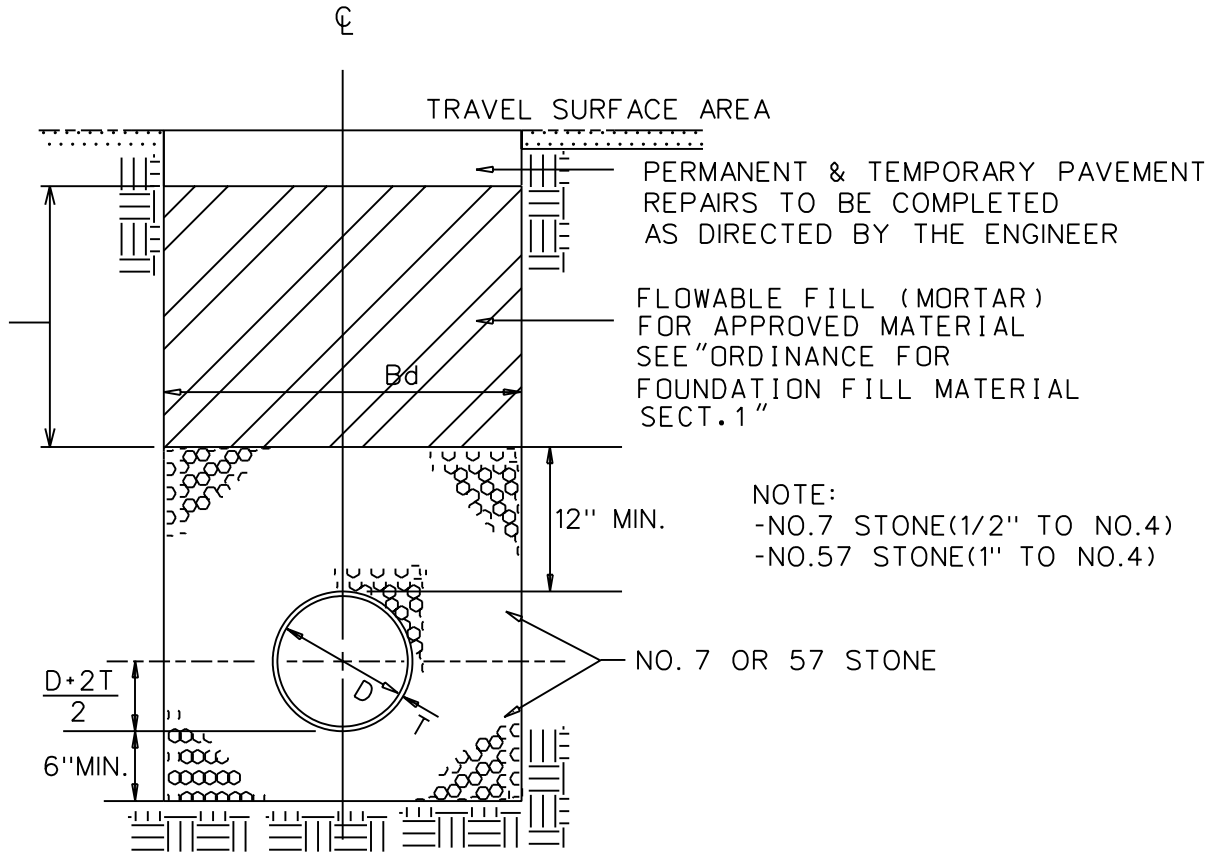

PIPE DIA. Inches	Bd TRENCH WIDTH TOP OF PIPE Feet
4"	2.00
6	2.00
8	2.33
10	2.50
12	2.67
15	3.00
18	3.25
21	3.54
24	3.83
27	4.08
30	4.42
33	4.75
36	5.67
42	6.25
48	6.83
54	7.42
60	8.00
66	8.58
72	9.17
78	9.75
84	10.33

Bd-Maximum Trench Width at 12" above top of Pipe if Ditch is cut wider than Bd shown the contractor will be required to increase bedding to compensate for additional load on pipe at his own expense.

TRENCH DETAIL FOR SEWER PIPE  
(FOR TRAVELED AREA INSIDE CITY LIMITS)  
FOR P.V.C., P.E. & D.I. PIPE.

200-25

200-25